

EXISTING PAVEMENT GRADE


3" ASPHALT HOT OR 3" COLD MIX WHEN APPROVED BY THE ENGINEERING DEPARTMENT

8" PUGMILL MIX COMPACTED IN 4" LAYERS

BACKFILL EXCAVATED MATERIAL IF CONDITION PERMITS. REPLACEMENT BACKFILL MATERIAL SHALL BE #7 CRUSHED STONE COMPACTED IN 6" LAYERS IF EXCAVATION MATERIAL IS UNSATISFACTORY.

DRAWING 1 TEMPORARY PATCH

DRAWING 2 PERMANENT PATCH

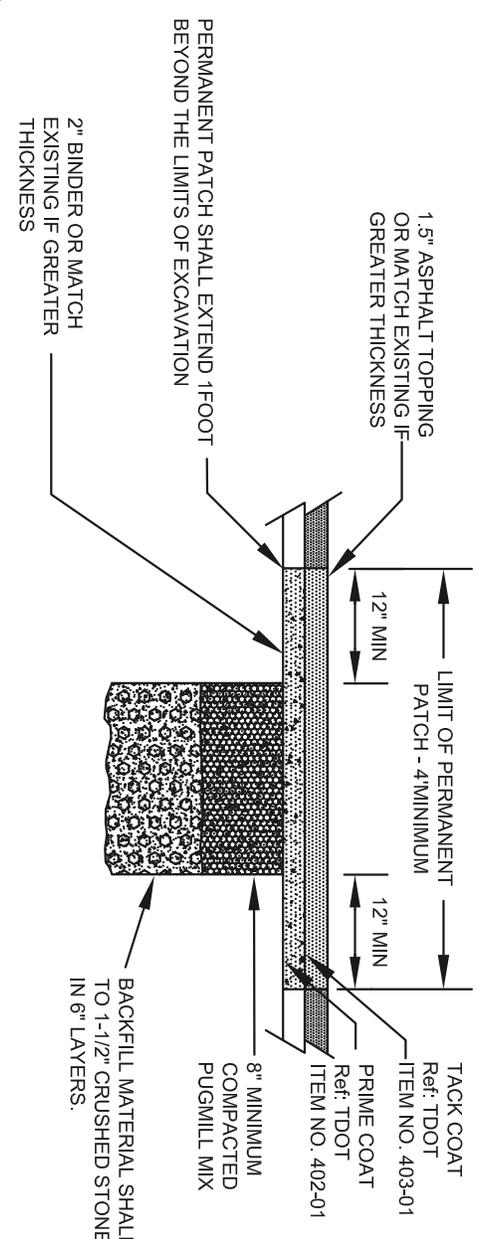

1.5" ASPHALT TOPPING OR MATCH EXISTING IF GREATER THICKNESS

2" BINDER OR MATCH EXISTING IF GREATER THICKNESS

LIMIT OF PERMANENT PATCH - 4 MINIMUM

12" MIN

12" MIN

TACK COAT Ref: TDOT ITEM NO. 403-01

PRIME COAT Ref: TDOT ITEM NO. 402-01

8" MINIMUM COMPACTED PUGMILL MIX

BACKFILL MATERIAL SHALL BE 3/4" TO 1-1/2" CRUSHED STONE COMPACTED IN 6" LAYERS.

PERMANENT PATCH SHALL EXTEND 1-FOOT BEYOND THE LIMITS OF EXCAVATION

- NOTE:
1. NOTIFY ENGINEERING DEPARTMENT INSPECTION PERSONNEL AT LEAST ONE (1) DAY PRIOR TO BEGINNING WORK.
 2. ALL EXCAVATIONS MADE WITHIN THE CITY OF COLUMBIA RIGHT-OF-WAY REQUIRE A PERMIT PRIOR TO BEGINNING WORK. CONTACT THE ENGINEERING DEPARTMENT AT 931-560-1530
 3. CONTRACTOR IS RESPONSIBLE FOR CONTACTING ALL UNDERGROUND UTILITIES PRIOR TO ANY EXCAVATION WORK.



STREET CUT REPAIR

(NTS)

DATE
4-23-2012

DWG. NO.

MD-06